





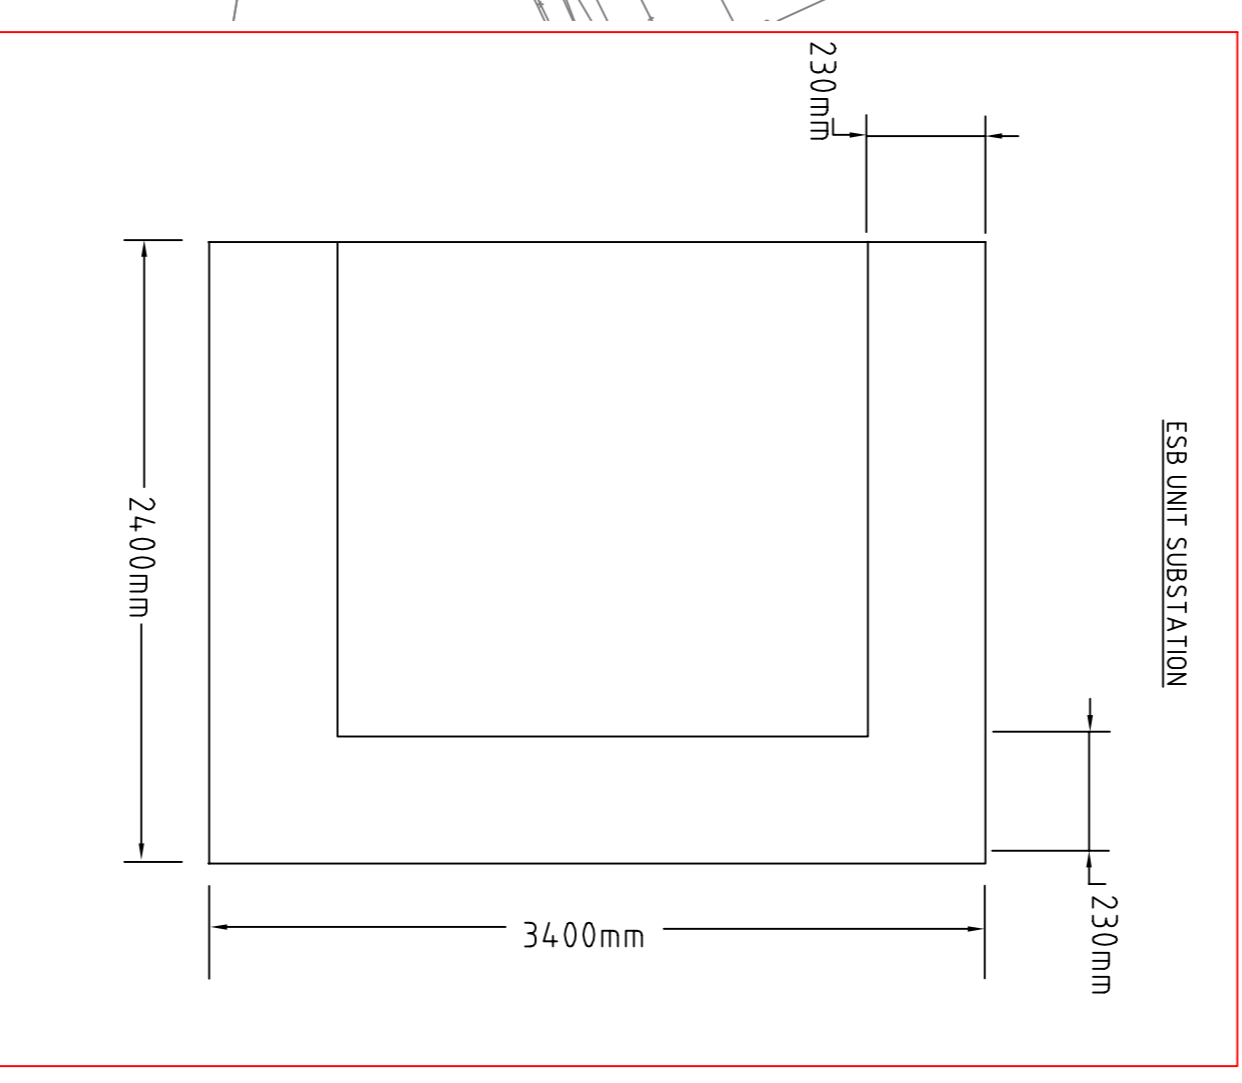
	ESB DUCTING
	LIGHTING DUCTING
	SERVICE CONNECTION DUCTING
	ESB MINI-PILLAR
	PUBLIC LIGHTING MINI-PILLAR
	ESB UNIT SUBSTATION
	EY CHARGING PILLAR (FUTURE)

NOTES:

- ESB TO FINALIZE DUCT REQUIREMENTS.
- DEPTH TO TOP ESB DUCT 600mm.
- GAP BETWEEN DUCTS TO BE 300mm.
- COMB DUCTS TO BE 300mm AWAY FROM ESB DUCTS AND STACKED ONE OVER THE OTHER DEPTH TO TOP 300mm.
- WATER MAIN TO BE 300mm FROM OTHER DUCTS.
- PUBLIC LIGHTING MINI-PILLAR TO BE PLACED WITHIN MIN. 200mm FROM ESB MINI-PILLAR.
- COMMS INFRASTRUCTURE IN THE VICINITY OF EACH MINI PILLAR INSTALLED SHALL BE CHANGES TO (4x 300mm) DEEP FOR WIRING, ERICOM & OTHER FROM EACH CHAMBER TAKE A 30mm DUCT TO AN ECU AT A 30mm DUCT TO APARTMENT HOT PRESS NOTE THAT WIRING & ERICOM CAN BE EXPECTED TO PROVIDE CHAMBER FRAMES, LIDS, DUCTS & FTUS.
- SERVICE CONNECTIONS DUCTS TO EACH APARTMENT TO BE 30mm.



Rev	Description	Date	Chkd	Appd	Rev	Description	Date	Chkd	Appd
A	INFORMATION ISSUE	17-07-20	KM	LM					
B	INFORMATION ISSUE	28-08-20	KM	LM					
C	INFORMATION ISSUE	09-12-20	KM	LM					

CLIENT



Comhairle Contae Fhine Gall
Fingal County Council

ARCHITECTURAL PRACTICE

obridain:beary

MB MURPHY BELTON CONSULTING ENGINEERS LTD

BT7 Ballymount Corporate Park
HAYESTOWN ROAD RUSH, DUBLIN 12
T + 353 (0)1 4289774
E info@murphybelton.ie
W www.murphybelton.ie

Project: **HAYESTOWN HOUSING**
HAYESTOWN ROAD RUSH, DUBLIN

Title: **ELECTRICAL SERVICES SITE SERVICES**

Scale: 1:50 @ A1

Drawn: FH

Engineer: KM

Project No: 2007

Drawing No: 2007-MB-ZZ-SS-DR-E-6001

Designer: E

Rev	Description
C	